

CLARIFICATION RESPONSE NO. 1

For The

WASHINGTON STREET SIDEWALK AND LIGHTING IMPROVEMENTS

May 26, 2016

Clarification No. 1

The light pole foundation detail shown on Drawing No. E2 indicates the required depth to be 72". This foundation detail is only required for the light pole and foundation replacement on Commerce Street at Macon Road as shown on Drawing No. C1 in the General Layout.

Light pole foundations installed along Washington Street as shown on Drawing No. E2 shall have a depth of 48". Please refer to the attached "Fixture Type 'P' Pole Foundation Detail".

Clarification No. 2

Light poles are shown in desired locations along Washington Street, but foundations may be in conflict with the existing gas main. The Contractor is responsible for verifying the location and depth of the existing gas main according to Georgia Dig Law. The cost for this verification shall be included in the unit price per each light pole installed. Verification shall be required prior to installation of any foundation. If the gas main is found to be in conflict, the Contractor is responsible for notifying GWES and the City before proceeding with light pole foundation installation.

Clarification No. 3

An alternate ADA ramp paver shall be truncated dome type brick, "54 Chocolate". This alternate will be provided as a separate pay item in the Proposal, which will be included in Addendum No. 1.

Clarification No. 4

The Contractor is responsible for traffic control according to his methods of construction. If the Contractor requires closure of one lane (or less) of Washington Street to complete the work, then he is responsible for coordinating such traffic control with the City of Perry. The cost for traffic control shall be included in the mobilization/demobilization lump sum price as defined in Section 01200, Measurement and Payment.

Clarification No. 5

Benchmarks and horizontal control points will be provided to the Contractor prior to construction. GWES will supply a digital file in Civil3D format for Contractor use during stakeout of the work.

Clarification No. 6

At locations where concrete and/or brick is saw-cut, the Contractor is responsible for chamfering the edges to reduce the likelihood of chipping. Cost for such work is to be included in the removal item to which it pertains in the Proposal.

Clarification No. 7

Liquidated damages are reduced to \$100 per day. This change will be handled in issuance of Addendum No. 1.

Clarification No. 8


In Specification Section 00200, Instructions to Bidders, Item 20, Funding, is inaccurate. The City of Perry will be funding the project. This change will be handled in Addendum No. 1.

Clarification No. 9

Electrical wiring from light poles designated as S1-A, S2-A, and S3-A shall be horizontally directional drilled (HDD) from location to location, not trenched. The change in quantities of trenching and HDD will be handled in Addendum No. 1.

Clarification No. 10

GWES will supply Section 00400, Proposal, in Addendum No. 1 for the Contractor's use in bid. Copying or removing Section 00400 from the Contract Documents will not be necessary.




Engineer of Record

May 26, 2016

Date



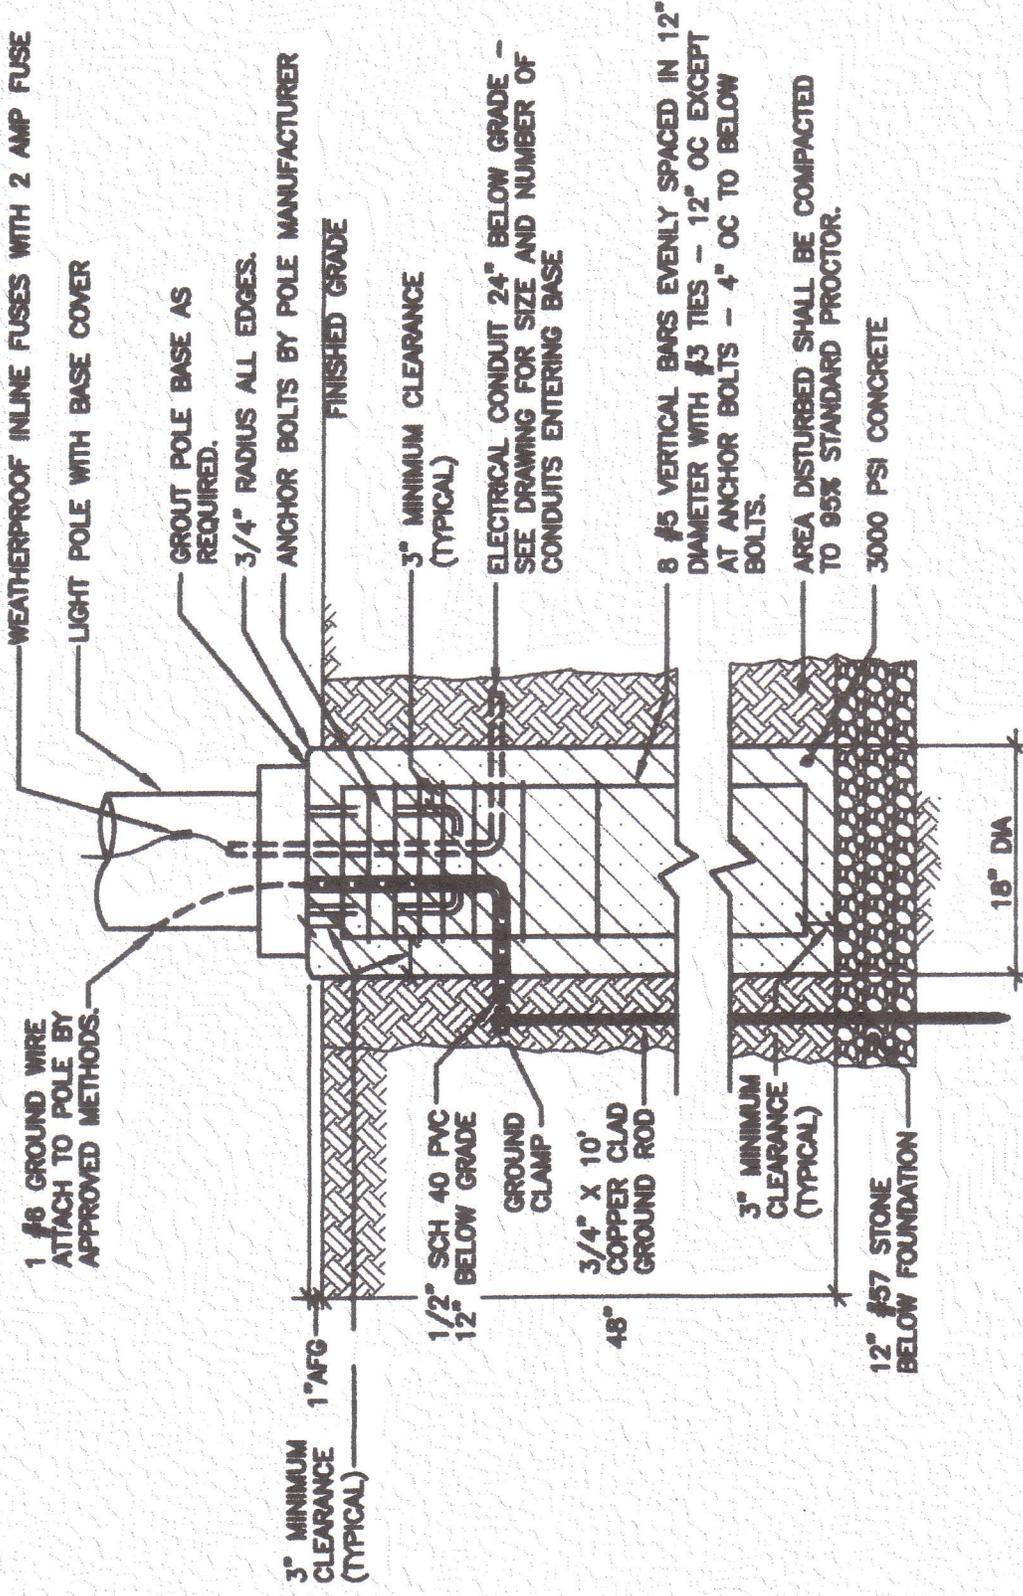

FIXTURE TYPE 'P'
POLE FOUNDATION DETAIL

3
 E-3

SCALE: N.T.S.



02-07-2016

W&A PROJECT NUMBER - 15117



2300 Lake Park Dr, Suite 250
 Smyrna, Georgia 30080
 Voice 770-458-3005 Fax 770-458-8388

PLOT SCALE: 1 = 1